



# LUND UNIVERSITY

## **Airborne bacteria during surgery in hospital operating rooms with different ventilation systems**

Alsved, Malin; Civilis, Anette; Ekolind, Peter; Tammelin, Ann; Erichsen Andersson, Annette; Jakobsson, Jonas; Svensson, Tobias; Ramstorp, Matts; Santl-Temkiv, Tina; Larsson, P A; Bohgard, Mats; Löndahl, Jakob

2016

[Link to publication](#)

### *Citation for published version (APA):*

Alsved, M., Civilis, A., Ekolind, P., Tammelin, A., Erichsen Andersson, A., Jakobsson, J., Svensson, T., Ramstorp, M., Santl-Temkiv, T., Larsson, P. A., Bohgard, M., & Löndahl, J. (2016). *Airborne bacteria during surgery in hospital operating rooms with different ventilation systems*. Abstract from Nordic Society for Aerosol Research 2016, Aarhus, Denmark, Aarhus, Denmark.

### *Total number of authors:*

12

### **General rights**

Unless other specific re-use rights are stated the following general rights apply:

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

Read more about Creative commons licenses: <https://creativecommons.org/licenses/>

### **Take down policy**

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

LUND UNIVERSITY

PO Box 117  
221 00 Lund  
+46 46-222 00 00

# Airborne bacteria during surgery in hospital operating rooms with different ventilation systems

M. Alsved<sup>1</sup>, A. Civilis<sup>2</sup>, P. Ekolind<sup>3</sup>, A. Tammelin<sup>4</sup>, A. Erichsen Andersson<sup>5</sup>, J. Jakobsson<sup>1</sup>, T. Svensson<sup>1</sup>,  
M. Ramstorp<sup>1</sup>, T. Santl Temkiv<sup>1</sup>, P.A. Larsson<sup>2</sup>, M. Bohgard<sup>1</sup>, J. Löndahl<sup>1</sup>.

<sup>1</sup>Department of Design Sciences, Lund University, Lund, Sweden

<sup>2</sup>Operating department, Region Skåne, Helsingborgs lasarett, Helsingborg, Sweden

<sup>3</sup>Avidicare AB, Medicon Village, Lund, Sweden

<sup>4</sup>Department of Medicine Solna, Unit of Infectious diseases, Karolinska Institutet, Stockholm.

<sup>5</sup>Institute of Health and Care Sciences, Sahlgrenska Academy, Göteborg, Sweden

Keywords: Operating theatre, Ventilation, Infection

## Introduction

Post-operative infections obtained from open-wound surgeries constitute an unnecessary load on both healthcare and affected patients. The annual cost for post-operative infections in Sweden is estimated to 4 billion SEK.

It is well established that increased air cleanliness reduces the number of post-operative infections. Therefore, the ventilation system is important in order to reduce the number of infectious particles in the air during surgery. Ventilation with high airflow, as in operating theatres, consumes a high amount of energy and it is thus desirable to find energy efficient solutions.

The purpose of this work is to evaluate air quality, energy efficiency and working comfort for different ventilation techniques in operating theatres.

## Methods

Three different ventilation systems were evaluated: turbulent mixed airflow (TMA), laminar airflow (LAF) and the newly developed technique temperature controlled airflow (TAF).

TAF is based on HEPA-filtered under-tempered air falling from air-showers arranged in a circle above the operating table, see Figure 1. This technique leads to the usage of lower airflow volumes and less fan power. Additional air-showers are located in the peripheral parts of the room, controlling the overall cleanliness of the air in the operating room.

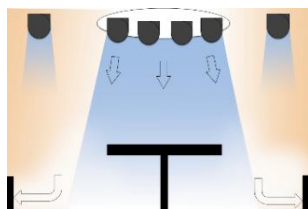


Figure 1: Schematic picture of the TAF ventilation system.

In total, measurements were performed during 45 elective operations at Helsingborg's hospital, 15 in each of the different ventilation systems. The concentration of colony forming units (CFU)/m<sup>3</sup> was measured at three locations in the room: close

(<0.5 m) to the wound, behind the operating staff and in the peripheral part of the room.

## Results

In this study we show that LAF and TAF, but not TMA, have less than 10 colony forming units (CFU)/m<sup>3</sup> at all locations in the operating room, which is in line with the recommendations in most countries (Figure 2). TAF has up to 30% lower energy consumption than LAF, which is related to the almost double airflow volume in LAF.

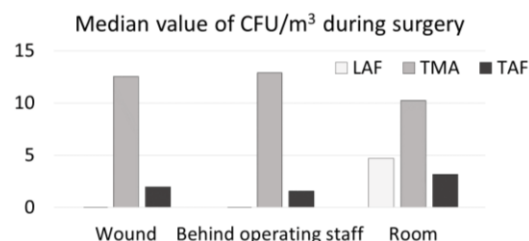


Figure 2: The diagram shows the different concentrations of CFU/m<sup>3</sup> in the three ventilation systems.

A questionnaire was given to the operating staff, and their answers showed that they experienced less disturbance from noise and draught in TMA and TAF than in LAF. The experienced working environment is of high importance since it is unwanted to expose the operator to additional stress.

## Conclusions

Reducing the CFU concentration in operating theatres is difficult, since most particles are emitted by the staff. Nevertheless, both the LAF and TAF ventilation keep high air cleanliness with low CFU concentrations throughout the operation. However, not all bacteria are able to form colonies on an agar plate, which is why more studies are needed with complementing measurement techniques. Further studies will include measurements using a high airflow fluorescence spectrometer that can distinguish between dead and active bacteria based on their auto fluorescence.

This work was supported by Avidicare AB, Swedish Energy Agency, FORMAS and AFA.