



LUND UNIVERSITY

Self Tuning Regulators : Paper Presented at MIT/NASA-AMES Workshop on Systems Reliability for Future Aircraft 1975.

Åström, Karl Johan

1976

Document Version:

Publisher's PDF, also known as Version of record

[Link to publication](#)

Citation for published version (APA):

Åström, K. J. (1976). *Self Tuning Regulators : Paper Presented at MIT/NASA-AMES Workshop on Systems Reliability for Future Aircraft 1975*. (Research Reports TFRT-3126). Department of Automatic Control, Lund Institute of Technology (LTH).

Total number of authors:

1

General rights

Unless other specific re-use rights are stated the following general rights apply:

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

Read more about Creative commons licenses: <https://creativecommons.org/licenses/>

Take down policy

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

LUND UNIVERSITY

PO Box 117
221 00 Lund
+46 46-222 00 00

3126

SELF-TUNING REGULATORS

K. J. ÅSTRÖM

Paper presented at

MIT/NASA - AMES WORKSHOP ON SYSTEMS
RELIABILITY FOR FUTURE AIRCRAFT
AUGUST 18 - 20 1975

Report 7603 (C) Januari 1976
Department of Automatic Control
Lund Institute of Technology

TILLHÖR REFERENSBIBLIOTEKET

UTLANAS EJ

SELF-TUNING REGULATORS

K.J. Åström

Department of Automatic Control
Lund Institute of Technology

1. INTRODUCTION

This paper gives a brief review of the results of a research project on self-tuning regulators which has been carried out at the Lund Institute of Technology. The project is part of a larger research program on adaptive control which has followed three main lines,

- A - Stochastic control
- B - Self-tuning regulators
- C - Analysis of adaptive regulators proposed in literature.

The approach via stochastic control which leads to dual control strategies has been very useful to provide understanding and insight. So far the results have, however, not been carried out to the stage of implementation. Self-tuning regulators are a particular version of adaptive regulators based on real-time identification. They are a special case of nondual stochastic control algorithms. The work on self-tuning regulators has progressed quite far in the sense that these regulators are reasonably well understood theoretically. They have also been tried extensively in several industrial applications. On the other hand there still remains a lot of work to be done to explore other aspects of these regulators. The third project C is needed to keep abreast of the development of other adaptive schemes. It has also resulted in

a long list of problems relating to understanding the strange behaviour of some algorithms in certain circumstances.

The basic idea underlying the self-tuning regulators is the following. If a description of a system and its environment is known there are many procedures available to design a control system subject to given specifications. When trying to remove the assumption that the models for the system and its environment are known we are immediately lead to the problem of controlling a system with constant but unknown parameters. This problem can in principle be solved by using stochastic control theory at the prize of exorbitant calculations. It is then meaningful to ask if there are simple control algorithms, which do not require information about the model parameters, such that the controller will converge to the controllers that could be designed if the model parameters were known. It is an empirical fact that such controllers exist in several cases. The investigation of their properties have also lead to powerful tools that can be used to analyse many other cases.

The generation of self-tuning algorithms is partly heuristic. It turns out that many algorithms can be obtained by combining a real-time identifier with a control scheme. In our work we have so far mostly considered regulators for the LQG regulator problem. This has been motivated by the particular applications we have considered. Many of the concepts and ideas can, however, be extended to many other design methods.

2. AN EXAMPLE

The main ideas will first be demonstrated using a simple example. Consider the simple discrete time system

$$y(t+1) + a y(t) = b u(t) + e(t+1) + c e(t) \quad (2.1)$$

where u is the input, y the output and $\{e(t)\}$ a sequence of independent, equally distributed, random variables. The number c is assumed to be less than one. Let the criterion be to minimize the variance of the output i.e.

$$\min V = \min E y^2 = \min E \frac{1}{t} \sum_{k=1}^t y^2(k) \quad (2.2)$$

It is easy to show that the control law

$$u(t) = \frac{a - c}{b} y(t) \quad (2.3)$$

is a minimum variance strategy, and that the output of the system (2.1) with the feedback (2.3) becomes

$$y(t) = e(t) \quad (2.4)$$

See e.g. Åström (1970). Notice that the control law (2.3), which represents a proportional regulator, can be characterized by one parameter only.

A self-tuning regulator for the system (2.1) can be described as follows:

ALGORITHM (Self-Tuning Regulator)

Step 1 (Parameter Estimation)

At each time t , fit the parameter α in the model

$$\hat{y}(k+1) + \alpha y(k) = u(k), \quad k = 1, \dots, t-1 \quad (2.5)$$

by least squares, i.e. such that the criterion

$$\sum_{k=1}^t \epsilon^2(k) \tag{2.6}$$

where

$$\epsilon(k) = y(k) - \hat{y}(k) \tag{2.7}$$

is minimal. The estimate obtained is denoted α_t to indicate that it is a function of time.

Step 2 (Control)

At each time t , choose the control

$$u(t) = \alpha_t y(t) \tag{2.8}$$

where α_t is the estimate obtained in step 1.

Motivation

There are several ways to arrive at the control strategy given above. The algorithm STURE can e.g. be interpreted as the certainty equivalence control for the corresponding stochastic control problem.

Analysis

The properties of a closed loop system controlled by a self-tuning regulator will now be discussed. Since the closed loop system is nonlinear, timevarying and stochastic, the analysis is not trivial.

It is fairly obvious that the regulator will perform well if it is applied to a system (2.1) with $b = 1$ and $c = 0$, because in this case the least squares estimate α_t will be an unbiased estimate of a . The regulator (2.8) will thus converge to a minimum variance regulator if the parameter estimate α_t converges. It is surprising, however, that the regulator will also converge to the minimum variance regulator if $c \neq 0$ as will be demonstrated below.

There may also be some difficulties because the control law is of the certainty equivalence type. Because of the special model structure (2.5) the feedback gain will however be bounded if the estimate α_t is bounded.

The least squares estimate is given by the normal equation

$$\frac{1}{t} \sum_{k=1}^t y(k+1)y(k) + \alpha_{t+1} \frac{1}{t} \sum_{k=1}^t y^2(k) = \frac{1}{t} \sum_{k=1}^t y(k)u(k)$$

Assuming that the estimate α_t converges towards a value which gives a stable closed loop system, then it is straightforward to show that

$$\frac{1}{t} \sum_{k=1}^t (\alpha_{t+1} - \alpha_k) y^2(k) \rightarrow 0$$

Thus the closed loop system has the property

$$\lim_{t \rightarrow \infty} \frac{1}{t} \sum_{k=1}^t y(t+1)y(t) = 0 \quad (2.9)$$

Furthermore, assuming that the system to be controlled is governed by (2.1), the output of the closed loop system obtained in the limit is given by

$$y(t) + [a - \alpha b] y(t) = e(t) + c e(t-1) \quad (2.10)$$

The covariance of $\{y(t)\}$ at lag 1 is then given by

$$E y(t+1)y(t) = -f(\alpha) = \frac{(c-a+\alpha b)(1-\alpha c+\alpha b c)}{1 - (\alpha - \alpha b)^2} \quad (2.11)$$

The condition (2.9) gives

$$f(\alpha) = 0$$

This is a second order equation for α which has the solutions

$$\alpha = \alpha_1 = \frac{a - c}{b}$$

$$\alpha = \alpha_2 = \frac{a - 1/c}{b}$$

The corresponding poles of the closed loop system are $\lambda_1 = c$ and $\lambda_2 = 1/c$ respectively. Since c was assumed less than one, only the value α_1 corresponds to a stable closed loop system. Notice that α_1 corresponds to the gain of the minimum variance regulator (2.3).

Hence, if the parameter estimate α_t converges to a value which gives a stable closed loop system, then the closed loop system obtained must be such that (2.7) holds. This means that the algorithm can be thought of as a regulator which attempts to bring the covariance of the output at lag one, i.e. $r_y(1)$, to zero in the same way as an integrating regulator brings the integral of the control error to zero.

If the system to be controlled is actually governed by (2.1), then the self-tuning regulator will converge to a minimum variance regulator if it converges at all.

Slide 1 shows the results of a simulation of the algorithm. It is clear from this simulation that the algorithm converges in the particular case. The least squares estimate will be a biased estimate of the model parameter $a = -0.5$ because of the correlation between the model errors. As can be expected from the previous analysis the bias is, however, such that the limiting regulator corresponds to the minimum variance regulator.

The lower part of slide 1 shows the asymptotic value of the loss function obtained if the regulator gain is fixed to the current value. It is clear from this slide that the loss function is very close to the minimum loss for the case of known parameter after 50 steps.

3. GENERALISATIONS

A regulator which generalizes the simple self-tuner of the previous section is shown in slide 2. The regulator can be thought of as being composed of three parts: a parameter estimator (block 1), a controller (block 3) and a third part (block 2), which relates the controller parameters to the estimated parameters. The parameter estimator acts on the process inputs and outputs and produces estimates of certain process parameters. The controller is simply a linear filter characterized by the coefficients of its transfer function. These coefficients are in general a non-linear function of the estimated parameters. This function is frequently not one to one. This way of describing the regulator is convenient from the point of view of explaining how it works. The subdivision is, however, largely arbitrary, and the regulator can equally well be regarded simply as one non-linear regulator. The functions of the blocks 1, 2 and 3 are also simple, but the interconnection of these blocks represents a system with a rather complex input-output relation. The partitioning of the regulator as indicated in slide 2 is also convenient from the point of view of implementation, because the parameter estimator and the controller parameter calculation are often conveniently time shared between several loops.

There are many different ways to estimate the parameters θ and to calculate the regulator parameters, ν . Some possibilities are shown in slide 3.

The complexity of the algebraic equation which relates the controller parameters to the estimated parameters can vary significantly. From a simple variable substitution for minimum variance regulators to solution of an algebraic Riccati equation for the general LQG case.

Analysis

A brief statement of some properties of the self-tuning regulators will now be given. The results are fairly technical and only a few main points will be given here. A review of available results are given in Åström, Borisson, Ljung and Wittenmark (1975). The major results were proven in Åström and Wittenmark (1973), Ljung (1974) and Ljung and Wittenmark (1974b).

For the analysis it is assumed that the process to be controlled is governed by

$$A(q^{-1}) y(t) = B(q^{-1}) u(t-h) + v(t) \quad (3.1)$$

where $A(q^{-1})$ and $B(q^{-1})$ are polynomials in the backward shift operator q^{-1} and $\{v(t)\}$ is a sequence of random variables with bounded fourth moment. The analysis will basically cover the case $\mu(t) \rightarrow 0$ as $t \rightarrow \infty$ which corresponds to the case when the parameters are constant.

The following problems can partially be resolved by analysis.

- o Overall stability of the closed loop system
- o Convergence of the regulator
- o The properties of the possible limiting regulators

The analysis is far from trivial because the closed loop system is a nonlinear time variable stochastic system. Even if the recursive identification schemes used are well known, their convergence properties are largely unknown except for the least squares case. The input is also generated by a time varying feedback, which introduces additional difficulties. If the process noise $\{v(t)\}$ is correlated, the least squares estimates will be biased and the bias will depend on the feedback used.

A global stability result was proven by Ljung and Wittenmark (1974). See slide 4. This result applies to a regulator

composed of a least squares identifier and a minimum variance controller. The result requires that the system (3.1) is minimum phase and that the time delay k and the parameter β_0 are known.

A key result in the analysis is the observation made by Ljung (1974) that the paths of the estimates are closely related to the trajectories of the differential equation

$$\begin{cases} \frac{d\theta}{d\tau} = S f(\theta) \\ \frac{dS^{-1}}{d\tau} = G(\theta) - S^{-1} \end{cases} \quad (3.2)$$

where

$$\begin{cases} f(\theta) = E [\Psi^T(t, \theta) \varepsilon(t, \theta)] \\ G(\theta) = E [\Psi^T(t, \theta) \Psi(t, \theta)] \end{cases} \quad (3.3)$$

In the particular case of the regulator LS+MV the control law is chosen in such a way that $\hat{y}(t, \theta) = 0$ and the stationary points are then given by

$$\theta = f(\theta) = E[y(t+1) \phi(t)] = 0$$

The regulator LS+MV thus attempts to zero the autocovariance of the output and the crosscovariance of the input and the output for certain lags. This result which generalizes the simple example discussed in section 2 was shown in Åström and Wittenmark (1972).

In this paper it was also shown that the equation

$$f(\theta) = 0 \quad (3.4)$$

has only one stationary solution for the regulator of LS+MV if the orders of the system and the model are compatible.

The differential equations (3.3) can be used in several different ways. Ljung has exploited them to construct both

convergence proofs and examples which shows that the parameter estimates are not converge. The differential equations have also been very useful in simulations. See e.g. Wittenmark (1973).

The simulations shown in slides 5, 6 and 7 illustrate the behaviour of different versions of the self-tuner.

4. THE SERVOPROBLEM

So far the self-tuning regulator has only been discussed in the framework of the regulator problem. It is straightforward to apply self-tuning to the servo-problem too. Clarke and Gawthrop (1974) proposes to do so by posing a linear quadratic problem for a servo problem.

Another approach is simply to introduce the reference values by the standard procedure using feedforward and an inverse model. In the case of known parameters the problem is handled as follows. Assume that the process is described by (3.1) and introduce the reference values $u^r(t)$ and $y^r(t)$ which satisfies the same dynamics as the process i.e.

$$A(q^{-1}) y^r(t) = B(q^{-1}) u^r(t-k) \quad (4.1)$$

Hence

$$A(q^{-1}) [y(t) - y^r(t)] = B(q^{-1}) [u(t-k) - u^r(t-k)] + v(t).$$

A design procedure for the regulator then gives the feedback

$$u(t) - u^r(t) = \frac{G(q^{-1})}{F(q^{-1})} [y(t) - y^r(t)]$$

If the command signal $y^r(t)$ is specified this gives

$$u(t) = \frac{A(q^{-1})}{B(q^{-1})} y^r(t+k) + \frac{G(q^{-1})}{F(q^{-1})} [y(t) - y^r(t)] \quad (4.2)$$

This system can not be realized unless the change in reference value is known or can be predicted k steps ahead. If this is not the case a timedelay in the response to of k units must be accepted.

Observe that the control law (4.2) can be written as

$$\begin{aligned} B(q^{-1}) F(q^{-1}) u(t) &= \\ &= G y(t) + (A(q^{-1}) F(q^{-1}) - q^{-k} G(q^{-1})) y^r(t+k) \end{aligned} \quad (4.2)$$

The servo-problem can be incorporated into the self-tuning regulator simply by changing the model in the parameter estimation step to

$$M: y(t) = - A(q^{-1})y(t-1) + B(q^{-1})u(t-k) + C(q^{-1})\varepsilon(t-1) + \\ + D(q^{-1})y^r(t-1)$$

and making the modification (4.2) in the control step.

5. APPLICATIONS

The self-tuning regulators are conveniently implemented using a digital computer. The simple regulator LS+MV requires no more than 30 lines of FORTRAN code while the regulator RML+LQ requires an order of magnitude more code because of the necessity of solving the algebraic Riccati equation in each iteration. The regulators have been applied to a number of industrial processes. Among the applications that are currently known to me I can mention

- o paper machine [Cegrell-Hedqvist (1973) and Borisson-Wittenmark (1974)]
- o digester [Cegrell-Hedqvist (1974)]
- o ore crusher [Borisson-Syding (1974)]
- o enthalpy exchanger [Jensen-Hänsel (1974)]
- o supertanker [Källström (1974)]

Several of these applications have been in operation for a long time. A self-tuning regulator has for example been running as an adaptive autopilot for a supertanker for more than a year.

Even if the regulators discussed automatically tune its parameters, it is necessary to determine some parameters in advance. These are for instance:

- o The number of parameters in the prediction model (p , r and s).
- o The initial values of the parameter estimates.
- o Value of any fixed parameters in the model.
- o Rate of exponential forgetting of past data in the estimation algorithm.
- o The sampling rate.

Experience has shown that it is fairly easy to make the proper choice in practice. These parameters are also much easier to choose than to directly determine the coefficients of a complex control law. It is our experience that system engineers without previous exposure to this type of algorithms have been able to learn how to use them after a short training period only.

There have also been several misapplications. The most common mistake is to attempt a self-tuner for a control design that will not work even if the parameters are known.

6. REFERENCES

Alsholm, O, Borisson, U, Stavnes, O and Wittenmark, B (1973):
"A feasibility study of self-tuning regulators". Report 7338,
Dept of Automatic Control, Lund Institute of Technology,
Lund Sweden, October 1973.

Andersson, L, Borisson, U, Braun, R and Syding, R (1973):
"A DDC loop between Lund and Kiruna for control of an ore
crusher". Report 7318(C), Dept of Automatic Control, Lund
Institute of Technology, Lund Sweden, June 1973.

Åström, K J (1970):
"Introduction to stochastic control theory". Academic Press,
New York, 1970.

Åström, K J (1974a):
"A self-tuning parameter estimator". Publication 74/55
(Research Report), Dept of Computing and Control, Imperial
College of Science and Technology, London SW7 2BT. Also
available as Report 7419(C), Dept of Automatic Control, Lund
Institute of Technology, Lund Sweden, August 1974.

Åström, K J (1974b):
"A self-tuning regulator for non-minimum phase systems".
Report 7411(C), Dept of Automatic Control, Lund Institute
of Technology, Lund Sweden, June 1974.

Åström, K J (1975):
"Theory and applications of self-tuning regulators". Proc
Théorie du contrôle méthodes numériques et modélisation des
systèmes informatiques, IRIA, Rocquencourt, June 1974,
Springer 1975. Also available as Report 7417(C), Dept of
Automatic Control, Lund Institute of Technology, Lund Sweden,
August 1974.

Åström, K J and Eykhoff, P (1971):

"System identification - A survey". Automatica 7 (1971), 123-162. Originally given as an invited survey paper IFAC Symposium on System Identification and Parameter Estimation, Prague, June 1970.

Åström, K J, Borisson, U, Ljung, L and Wittenmark, B (1975):

"Theory and applications of adaptive regulators based on recursive parameter estimation". Preprint IFAC 6th World Congress, Boston, 1975.

Åström, K J and Wittenmark, B (1971):

"Problems of identification and control". JMAA 34 (1971), 90-113.

Åström, K J and Wittenmark, B (1972):

"On the control of constant but unknown systems". Preprints IFAC 5th World Congress, Paris, 1972.

Åström, K J and Wittenmark, B (1973):

"On self-tuning regulators". Automatica 9 (1973), 185-199.

Åström, K J and Wittenmark, B (1974):

"Analysis of a self-tuning regulator for non-minimum phase systems". Preprints IFAC Symposium on Stochastic Control, Budapest, 1974. Also available as Report 7418(C), Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, August 1974.

Athans, M (1971) (editor):

"Special issue on linear-quadratic-Gaussian problem". IEEE Trans AC-16, December 1971.

Bar-Shalom, Y, Tse, E and Larson, R E (1974):

"Some recent advances in the development of closed-loop stochastic control and resource allocation algorithms". IFAC Symposium on Stochastic Control Theory, Budapest, 1974.

Bohlin, T (1970):

"Information pattern for linear discrete-time models with stochastic coefficients". IEEE Trans AC-15 (1970), 104-106.

Borisson, U and Wittenmark, B (1973):

"Moisture content control on a papermachine - An application of a self-tuning regulator". Report 7337, Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, November 1973.

Borisson, U and Wittenmark, B (1974):

"An industrial application of a self-tuning regulator". Preprints IFAC Symposium on Digital Computer Applications to Process Control, Zürich, 1974.

Borisson, U and Syding, R (1973):

"Control of an ore crusher - A feasibility study of self-tuning control and remote processing". Report 7318, Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, June 1973.

Borisson, U and Syding, R (1974):

"Self-tuning control of an ore crusher". Preprint IFAC Symposium on Stochastic Control, Budapest, 1974. To appear in Automatica.

Borisson, U (1975):

"Self-tuning regulators - Industrial applications and multi-variable theory". Report 7513(Thesis), Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, October 1975.

Cegrell, T and Hedqvist, T (1973):

"Successful adaptive control of paper machines". Preprints 3rd IFAC Symposium on Identification and System Parameter Estimation, Hague, 1973. To appear in Automatica.

Cegrell, T and Hedqvist, T (1974):

"A new approach to continuous digester control". Preprints 4th IFAC/IFIP International Conference on Digital Computer Applications to Process Control, Zürich, 1974.

Clarke, D W and Gawthrop, B A (1975):

"A self-tuning controller". Technical Report, Dept of Eng Sci, Oxford, 1975. (Submitted to IEE)

Clarke, D W and Gawthrop, P J (1974):

"A generalisation of the self-tuning regulator". Report, Dept of Eng Sci, Oxford University, England, 1974.

Farison, J B (1967):

"Parameter identification for a class of linear discrete systems". IEEE Trans AC-12 (1967), 109.

Florentin, J J (1962):

"Optimal probing, adaptive control of a simple bayesian system". Int J on Control 13 (1962) 165-177.

Gallier, P W and Otto, R E (1969):

"Self-tuning computer adapts DDC algorithms in progress in direct digital control". Edited by T J Williams and F M Ryan, ISA.

Gawthrop, P J and Clarke, D W (1974):

"Simulation of a generalized self-tuning regulator". Report, Dept of Eng Sci, Oxford University, England, 1974.

Gustavsson, I, Ljung, L and Söderström, T (1974):

"Identification of linear, multivariable process dynamics using closed loop estimation". Report 7401, Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, January 1974.

Hetthéssy, J and Keviczky, L (1974):

"Some innovations to the minimum variance control". Preprints IFAC Symposium on Stochastic Control, Budapest, September 1974

Holst, J (1974):

"Användande av självinställande prediktorer för prognos av belastning i kraftsystem (Using self-tuning predictors for load prediction)" (in Swedish). Report 7433(C), Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, December 1974.

Hughes, D J and Jacobs, O L R (1974a):

"Turn-off, escape and probing in non-linear stochastic control". Preprints IFAC Symposium on Stochastic Control Theory, Budapest, September 1974.

Hughes, D J and Jacobs, O L R (1974b):

"Simultaneous identification and control using a neutral control law". Report, Dept of Eng Sci, Oxford University, England.

Jacobs, O L R (1974):

"Structure of stochastic control laws". IMA Conference on Stochastic Programming, Oxford University, July 1974.

Jacobs, O L R and Langdon, S M (1970):

"An optimal extremal control system". Automatica 6 (1970) 297-301.

Jacobs, O L R and Hughes, D J (1975):

"Simultaneous identification and control using a neutral control law". Preprints IFAC Congress, Boston, August 1975.

Jensen, L and Hänsel, R (1974):

"Computer control of an enthalpy exchanger". Report 7417, Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, October 1974.

Kalman, R E (1958):

"Design of a self-optimizing control system". Trans of the ASME 80 (1958) 468-478.

Källström, C (1974):

"The Sea Scout experiments". Report 7407(C), Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, April 1974.

Ljung, L (1973):

"Convergence of recursive stochastic algorithms". IFAC Symposium on Stochastic Control, Budapest, 1973. Also Report 7403, Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, February 1974.

Ljung, L (1974):

"Stochastic convergence of algorithms for identification and adaptive control". Thesis Report 7406, Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, March 1974.

Ljung, L and Wittenmark, B (1974a):

"Analysis of a class of adaptive regulators". Preprint IFAC Symposium on Stochastic Control, Budapest, 1974.

Ljung, L and Wittenmark, B (1974b):

"Asymptotic properties of self-tuning regulators". Report 7404, Dept of Automatic Control, Lund Institute of Technology, February 1974.

Nahorski, Z (1974):

"Simultaneous identification and control of linear discrete-time system using dual control concept". IFAC Symposium on Stochastic Control, Budapest, September 1974.

Nahorski, Z and Vidal, R (1974):

"Stabilization of linear discrete-time systems using simultaneous identification and control". Int J on Control 19 (1974) 353-364.

Panuska, V (1968):

"A stochastic approximation method for identification of linear systems using adaptive filtering". JACC.

Peterka, V (1970):

"Adaptive digital regulation of a noisy system". Paper No 6.2, Preprints 2nd IFAC Symposium on Identification and Process Parameter Estimation, Prague, 1970.

Peterka, V and Åström, K J (1973):

"Control of multivariable systems with unknown but constant parameters". Preprint 3rd IFAC Symposium on Identification and System Parameter Estimation, The Hague, June 1973.

Söderström, T, Ljung, L and Gustavsson, I (1974):

"A comparative study of recursive identification methods". Report 7427, Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, December 1974.

Tse, E and Bar-Shalom, Y (1973):

"An actively adaptive control for linear systems with random parameters via the dual control approach". IEEE Trans AC-18 (1973) 109-117.

Tse, E, Bar-Shalom, Y and Meier, III, L (1973):

"Wide-sense adaptive dual control for nonlinear stochastic systems". IEEE Trans AC-18 (1973) 98-108.

Vanecek, A (1974):

"Coupled air/fuel dynamic optimization and temperature regulation: A case study in stochastic control". Preprints IFAC Symposium on Stochastic Control, Budapest, September 1974.

Wellstead, P E and Edmunds, J M (1975a):

"Least squares identification at closed loop systems". Report, University of Manchester, 1975.

Wellstead, P E and Edmunds, J M (1975b):

"On-line process identification and regulation" Report, University of Manchester, 1975.

Wieslander, J and Wittenmark, B (1971):

"An approach to adaptive control using real time identification". Automatica 7 (1971) 211-217.

Wittenmark, B (1973a):

"A self-tuning regulator". Report 7311, Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, April 1973.

Wittenmark, B (1973b):

"Self-tuning regulators". Report 7312 (thesis), Dept of Automatic Control, Lund Institute of Technology, Lund Sweden, April 1973.

Wittenmark, B (1974a):

"Adaptive control of a paper-machine". Preprint Computer, Electronics and Control Conference, Calgary, May 1974.

Wittenmark, B (1974b):

"A self-tuning predictor". IEEE Trans AC-19 (1974) 848-851.

Wouters, W R E (1974):

"Parameter adaptive regulatory control for stochastic SISO systems. Theory and applications". Preprints IFAC Symposium on Adaptive Control, Budapest, September 1974.

SIMULATIONS

EXAMPLE 1

$$y(t) + ay(t-1) = bu(t-1) + e(t) + ce(t-1)$$

$$a = -0.5, \quad b = 3, \quad c = 0.7$$


MIN VARIANCE REGULATOR

$$u(t) = \frac{a-c}{b} y(t) = -0.4 y(t)$$


MODEL


$$y(t) + ay(t-1) = \beta_0 u(t-1) + e(t)$$

PARAMETER ESTIMATE

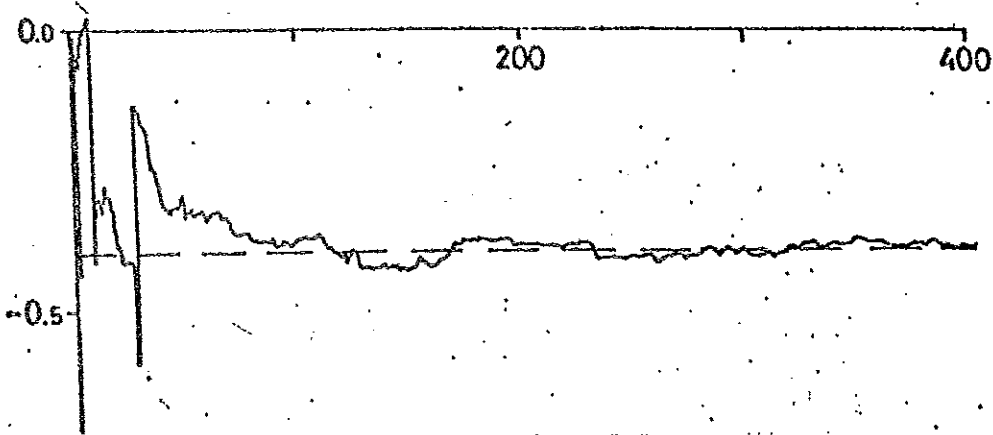

EXPECTED VARIANCE

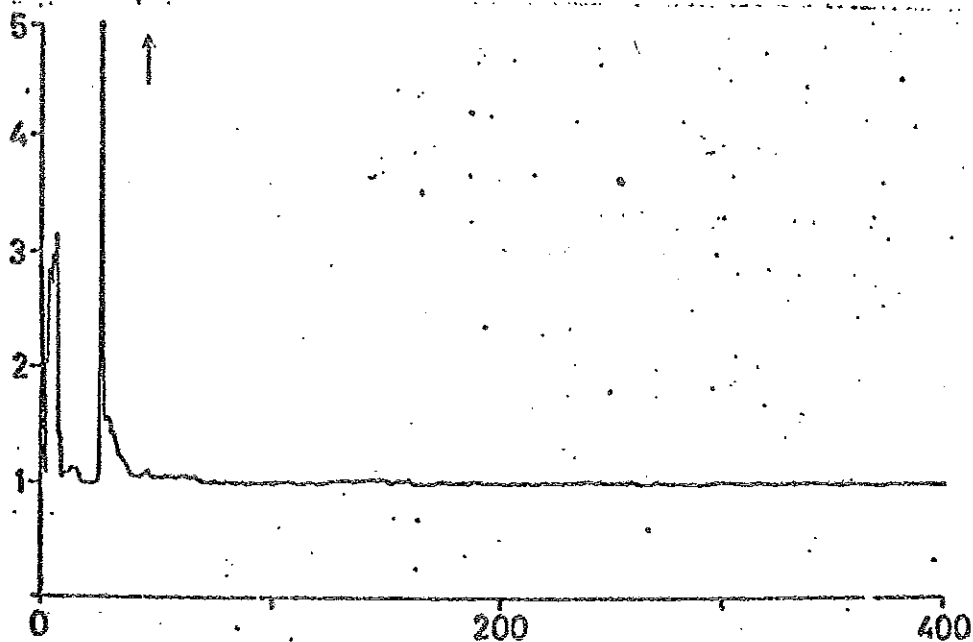

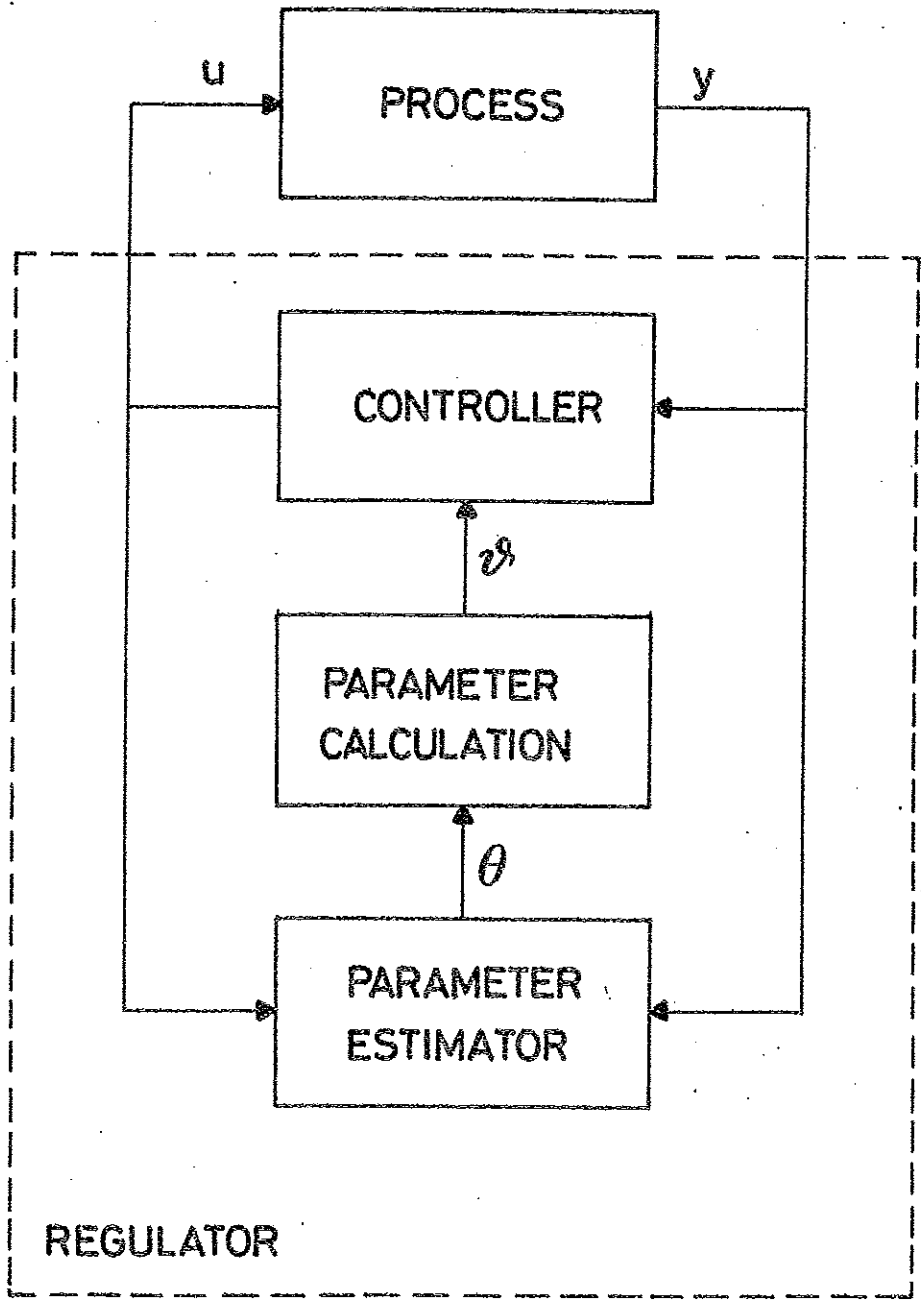

PARAMETER ESTIMATION

$$\hat{y}(t) = -A(q^{-1})y(t-1) + B(q^{-1})u(t-1) + \mathcal{E}(q^{-1})\varepsilon(t-1)$$
$$= \varphi(t)\theta \quad (\text{MODEL } \mathcal{M})$$

$$\varepsilon(t, \theta) = y(t) - \varphi(t)\theta =$$

$$\theta(t+1) = \theta(t) + \mu(t)S(t+1)\psi^T(t)\varepsilon(t, \theta(t))$$

$$S^{-1}(t+1) = S^{-1}(t) + \mu(t+1) [\psi^T(t+1)\psi(t+1) - S^{-1}(t)]$$

$$\text{ELS: } \varphi(t) = \psi(t) \quad \text{LS: } \mathcal{E} = 0$$

$$\text{RML: } \psi(t) = -\text{grad}_{\theta} \varepsilon(t, \theta)$$

CONTROL STRATEGIES

$$u(t) = \frac{G(q^{-1})}{F(q^{-1})} y(t)$$

REGULATOR PARAMETERS

$$\mathcal{V} = \text{col} [g_1 \ g_2 \ \dots \ g_m \ f_1 \ f_2 \ \dots \ f_1]$$

MINIMUM VARIANCE (DEAD BEAT)

$$\text{LINEAR QUADRATIC } \Sigma [y^2(t) + u^2(t)]$$

THEOREM

LET THE SYSTEM BE CONTROLLED BY REGI (LS+MV)
IF TIME DELAY k AND β_0 ARE KNOWN, IF THE ORDER
IS NOT UNDERESTIMATED AND IF

$$\limsup 1/N \sum v^2(t) < \infty$$

THEN

$$\limsup 1/N \sum y^2(t) < \infty$$

IF THE SYSTEM IS MINIMUM PHASE THEN ALSO

$$\limsup 1/N \sum u^2(t) < \infty$$

EXAMPLE 1


SYSTEM

$$y(t) - 0.95y(t-1) = u(t-2) + e(t) - 0.7e(t-1)$$

MODEL

$$y(t) = -\alpha y(t-2) + u(t-2) + \beta u(t-3)$$

ALGORITHMS : LS + MV

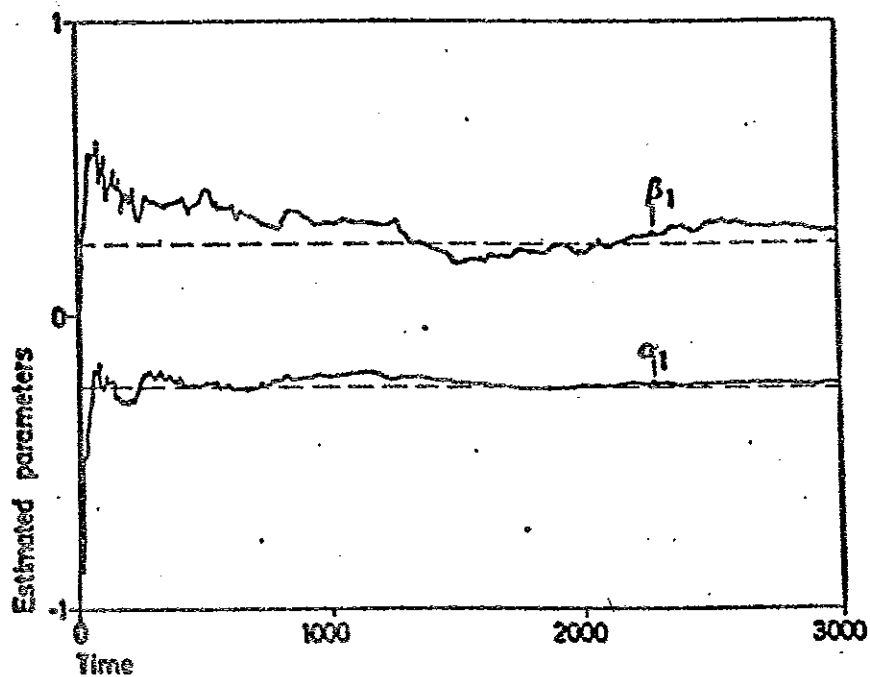

EXAMPLE 2


SYSTEM

$$y(t) - 0.95y(t-1) = u(t-2) + 2u(t-3) + e(t) - 0.7e(t-1)$$

MODEL

$$\hat{y}(t) = -\alpha y(t-1) + \beta_1 u(t-2) + \beta_2 u(t-3)$$

ALGORITHMS: LS+LQ (RICCATI)

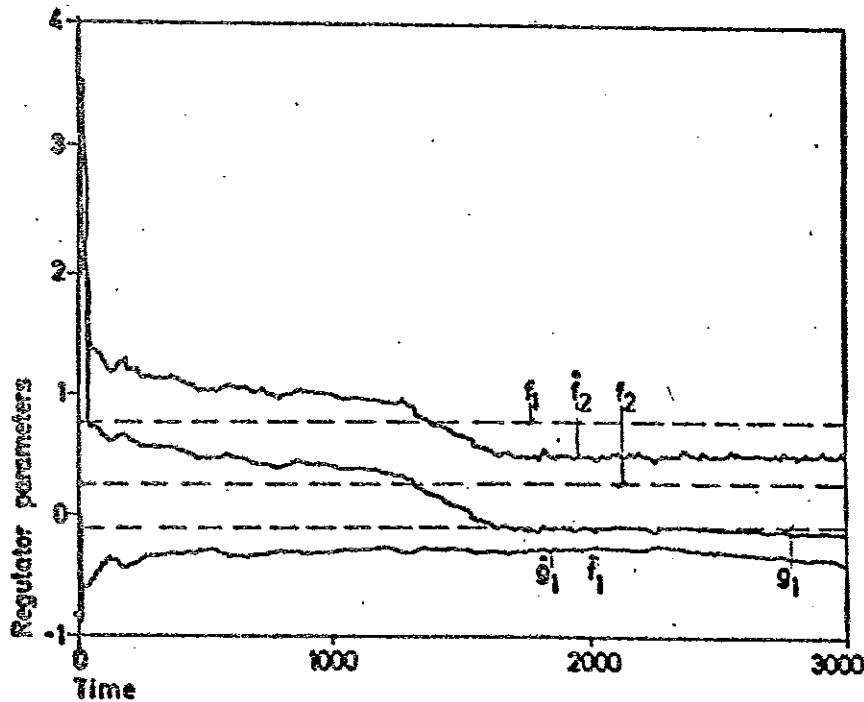

EXAMPLE 3

SYSTEM

$$y(t) - 0.95y(t-1) = u(t-2) + 2u(t-3) + e(t) - 0.7e(t-1)$$

MODEL

$$y(t) = -\alpha y(t-1) + \beta_1 u(t-2) + \beta_2 u(t-3) + \gamma \varepsilon(t-1)$$

ALGORITHMS: ELS + LQ (RICCATI)

